


PANELBOARD SCHEDULE										NEW LP1-A2	
PANELBOARD COMPLETE WITH GROUND BAR											
120/208	VOLTS	3 PHASE	4 WIRE SOLID NEUTRAL	FLUSH MOUNT	200	MAIN C/B	NQ	TYPE			
AMPS	P	LOCATION	WATTS	A	B	C	WATTS	LOCATION	P	AMPS	
20	1	RECEPS. FRIDGE & COUNTER	1	1500	1750		250	2	RECEPS. CABINET HEATERS	1	20
20	1	RECEPS. MICROWAVE	3	1200		1450	250	4	EXHAUST FANS	1	20
20	1	RECEPS. COUNTER	5	1500		1800	300	6	RECEPS. EXISTING TOILETS	1	20
20	1	RECEPS. CABINET HEATERS	7	250	1150		900	8	DRINKING FOUNTAINS	1	20
20	1	SPARE	9			1500	1500	10	RECEPS. FRIDGE AND COUNTER	1	20
20	1	SPARE	11			1200	1200	12	RECEPS. MICROWAVE	1	20
20	1	RECEPS. VENDING	13	1800	3300		1500	14	RECEPS. COUNTER	1	20
20	1	RECEPS. VENDING	15	1800		2520	720	16	RECEPS. GENERAL USE	1	20
20	1	RECEPS. VENDING	17	1800		1980	180	18	RECEPS. TOILET	1	20
20	1	SPARE	19		720		720	20	RECEPS. OPEN OFFICE 113	1	20
20	1	RECEPS. SALES	21		190		190	22	RECEPS. GENERAL USE	1	20
20	1	RECEPS. PLASMA TV	23	900		1700	900	24	RECEPS. MANAGER 114	1	20
20	1	RECEPS. SALES	25	720	1220		500	25	SOUND SYSTEM	1	20
20	1	RECEPS. SALES	27	180		720	540	28	RECEPS. SALES	1	20
20	1	RECEPS. ASSIST MGR	29	360		2160	1800	30	LIGHTING SALES LTG TRACK	1	20
20	1	RECEPS. ASSIST MGR	31	360	360		32	SPARE	1	20	
20	1	RECEPS. ASSIST MGR	33	180		180	720	34	SPARE	1	20
20	1	RECEPS. ASSIST MGR	35	360		1980	1500	36	RECEPS. CAMPUS MAIL	1	20
20	1	RECEPS. SALES	37	360	1800		1500	38	RECEPS. DICKSON MAIL	1	20
20	1	RECEPS. SALES	39	540		720	180	40	RECEPS. SPRINKLER ROOM	1	20
20	1	SPARE	41			540	540	42	RECEPS. ARROWHEAD PREP	1	20
			10360		7270		11300				
			86.33		60.58		94.17		AMPS		
TOTAL WATTAGE			28930		NEW PANEL TYPE NQ SERIES: COPPER BUS, 10KAIC						
CONNECTED LOAD			80		TYPEWRITTEN DIRECTORY, HINGED FRONT PANEL.						

PANELBOARD SCHEDULE										NEW LP1-A	
PANELBOARD COMPLETE WITH GROUND BAR											
120/208	VOLTS	3 PHASE	4 WIRE SOLID NEUTRAL	FLUSH MOUNT	225	MLO	NQ	TYPE			
AMPS	P	LOCATION	WATTS	A	B	C	WATTS	LOCATION	P	AMPS	
20	1	RECEPS. BUY BACKS ON-LINE	1	800	1300		500	2	SPOT LIGHTS @ WEST PANEL	1	20
20	1	RECEPS. OFFICE RECEIPT	3	800		1300	500	4	FRASHYARD LIGHTING	1	20
20	1	RECEPS. BOOKSTORE OFFICE	5	800		800	800	6	SPARE	1	20
20	1	RECEPS. WATCH	7	800	800			8	SPARE	1	20
20	1	RECEPS. TV, ROOL-UP DOOR	9	1500		1500		10	SPARE	1	20
20	1	RECEPS. CHIEF	11	900		900		12	SPARE	1	20
20	1	RECEPS. OFFICE STORAGE	13	540	1540		1000	14	RECEPS. CABINET HEATERS	1	20
20	1	RECEPS. OFFICE STORAGE	15	540		780	250	16	EXH FAN: TOILET	1	20
20	1	RECEPS. GENERAL USE	17	500		500		18	SPARE	1	20
20	1	RECEPS. RECEIVING	19	900	900			20	SPARE	1	20
20	1	RECEPS. OFFICE STORAGE	21	900		1440	540	22	RECEPS. GENERAL USE	1	20
20	1	COPPER	23	1800		2900	800	24	RECEPS. TELCO ROOM	1	20
20	1	RECEPS. DR. OFFICE	25	720	1080		360	26	RECEPS. OPEN OFFICE	1	20
20	2	SPARE	27			800	800	28	RECEPS. OPEN OFFICE	1	20
X	X		29			360	360	30	RECEPS. OPEN OFFICE	1	20
20	1	RECEPS. PUBLIC SAFETY	31	500	2300		1800	32	COPPER	1	20
20	1	RECEPS. PUBLIC SAFETY	33	1200		1740	540	34	RECEPS. SALES ENTRY	1	20
20	1	SPARE	35			720	720	36	RECEPS. RFID SYSTEM	1	20
20	1	SPARE	37			540	540	38	RECEPS. SALES ENTRY	1	20
20	1	SPARE	39			1127	1127	40	DOOR OPERATOR	1	20
20	1	RECEPS. RECEPTION	41	500		1627	1127	42	DOOR OPERATOR	1	20
			8460		8697		7507				
			70.5		72.48		62.56		AMPS		
TOTAL WATTAGE			24664		NEW PANEL TYPE NQ SERIES: COPPER BUS, 10KAIC						
CONNECTED LOAD			69		TYPEWRITTEN DIRECTORY, HINGED FRONT PANEL.						

PANELBOARD SCHEDULE										EXISTING L1-A	
PANELBOARD COMPLETE WITH GROUND BAR											
211/480	VOLTS	3 PHASE	4 WIRE SOLID NEUTRAL	FLUSH MOUNT	EXISTING MLO	NF	TYPE				
AMPS	P	LOCATION	WATTS	A	B	C	WATTS	LOCATION	P	AMPS	
20	1	SPARE	1			2500	2500	2	LIGHTING SALES	1	20
20	1	LIGHTING OFFICES	3	1740.5		3340.5	1900	4	LIGHTING CORR, TLTS, STRS	1	20
20	1	LIGHTING OFFICES	5	1566		2901.5	1423.5	6	LIGHTING NORTH RENOVATION	1	20
20	1	LIGHTING SALES	7	1742	2755		1013	8	LIGHTING OFFCS, BRK RM	1	20
20	1	SPARE	9			0		10	SPARE	1	20
20	1	SPARE	11			0		12	SPARE	1	20
15	3	NEW JOCKEY PUMP	13		0			14	SPACE		
X	X		15			0		16	SPACE		
X	X		17			0		18	SPACE		
			57.10		3349.5		2981.5				
			20.61		12.09		10.8		AMPS		
TOTAL WATTAGE			12051		PROVIDE NEW TYPEWRITTEN DIRECTORY						
CONNECTED LOAD			15								

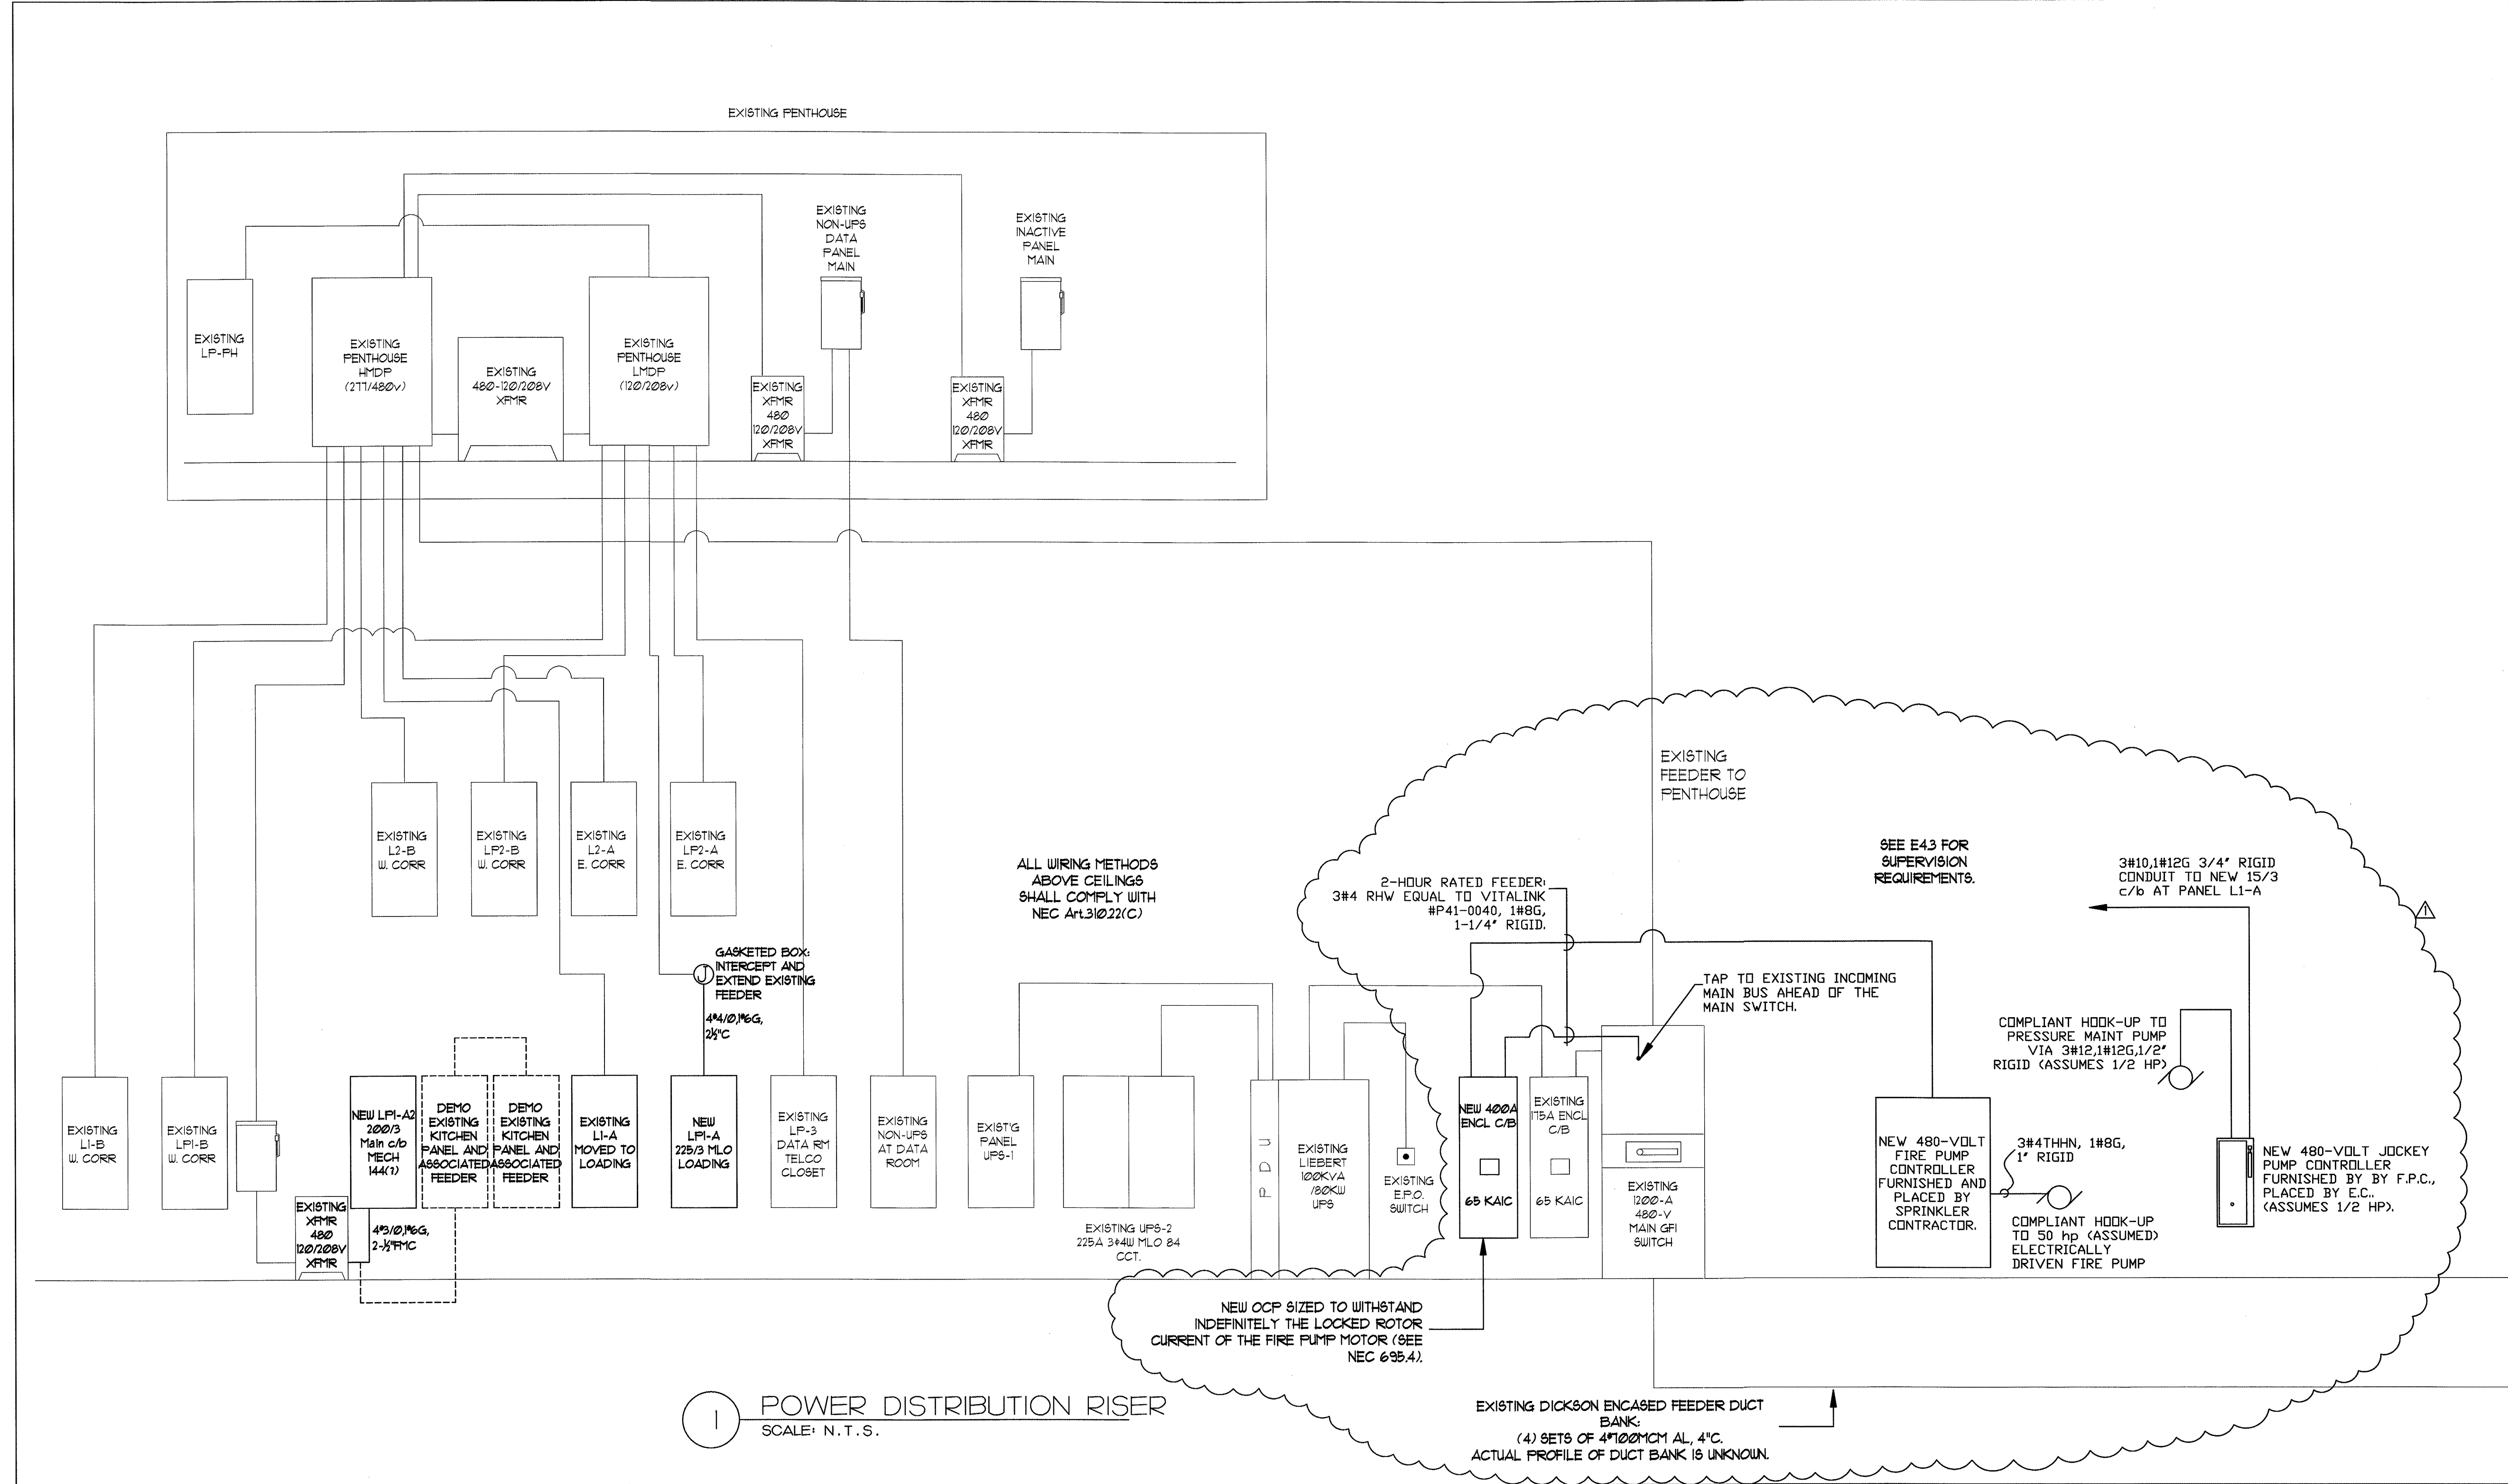

1/10/2010 1:44 PM
 COPYRIGHT © 2010 ALL RIGHTS RESERVED

CORDOGAN, CLARK & ASSOCIATES, INC. • ARCHITECTS • ENGINEERS
 www.cordoganclark.com
 716 North Wells Street
 Chicago, Illinois 60606
 Phone: 312.443.4877
 Fax: 312.443.4871

POWER DISTRIBUTION RISER
 S. NORTONSON CENTER REMODEL
 WAUBONSEE COMMUNITY COLLEGE
 RT.47 AT WAUBONSEE DRIVE
 SUGAR GROVE, ILLINOIS 60554

JOB NUMBER: 09324
 DATE: 12-16-09
 BID SET
 REVISIONS:
 12/29/09 APPENDIX 1
 SHEET:

E4.2